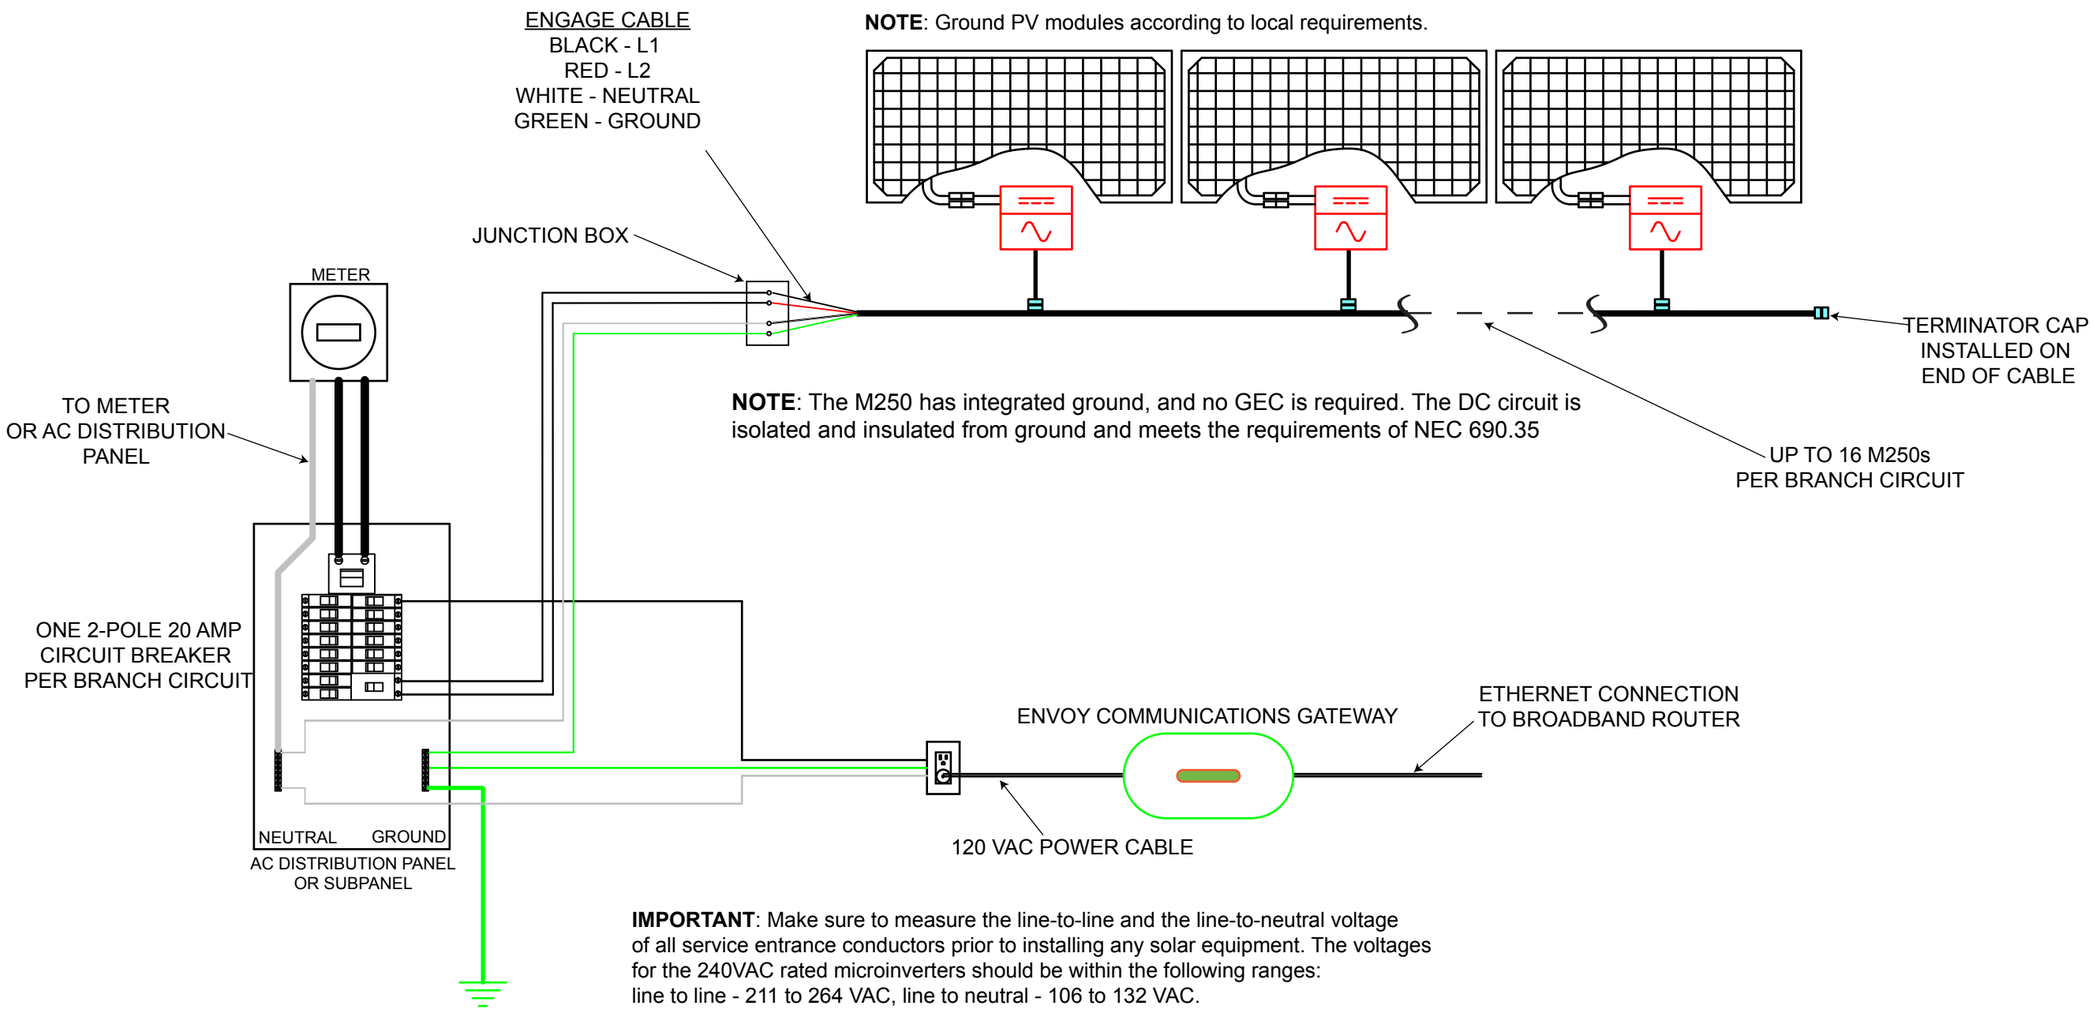

IMPORTANT: Make sure to measure the line-to-line and the line-to-neutral voltage of all service entrance conductors prior to installing any solar equipment. The voltages for the 240VAC rated microinverters should be within the following ranges:
line to line - 211 to 264 VAC, line to neutral - 106 to 132 VAC.

ENPHASE M250 MICROINVERTER FIELD WIRING DIAGRAM 240 VAC SINGLE PHASE

© 2013 Enphase Energy Inc. All rights reserved